

Setup UPS Backup with Back-UPS ES 750

- [Overview](#)
- [Battery Details](#)
- [USB Cable](#)
- [Software Setup](#)
 - [Master \(connected by USB\)](#)
 - [Network Slaves](#)
- [References](#)

Overview

Model: Back-UPS ES 750



Battery Details

Specification	Detail
---------------	--------

Image	<table border="1"><caption>Constant Voltage Charge (25 °C)</caption><thead><tr><th>Type</th><th>Initial Current</th></tr></thead><tbody><tr><td>Standby use</td><td>13.5V-13.8V</td></tr><tr><td>Cycle use</td><td>14.5V-14.8V</td></tr></tbody></table>	Type	Initial Current	Standby use	13.5V-13.8V	Cycle use	14.5V-14.8V
Type	Initial Current						
Standby use	13.5V-13.8V						
Cycle use	14.5V-14.8V						
Part	AJC-D7S						
Voltage	12v						
Capacity	7Ah						
Type	Sealed Lead Acid (AGM)						
Terminals	F2						
Length	5.94 in						
Width	2.56 in						
Height	3.7 in						
Weight	4.5 lbs						


USB Cable

Part: AP9827

The USBUPS06 6-foot Smart UPS Replacement USB Cable features 1 USB Type 'A' (male) connector and 1 10-Pin RJ45 male connector, allowing you to communicate from your computer, work station or server to your UPS power supply.

Our affordable and cost-effective USB UPS cable can be used as a direct replacement to the AP9827, providing you with the same capabilities at an inexpensive price.

https://www.amazon.ca/StarTech-com-USBUPS06-Replacement-AP9827-6-Feet/dp/B004DVEWHY/ref=sr_1_4?dchild=1&keywords=startech.com+6ft+smart+ups+replacement+usb+cable+ap9827&qid=1629651544&s=electronics&sr=1-4

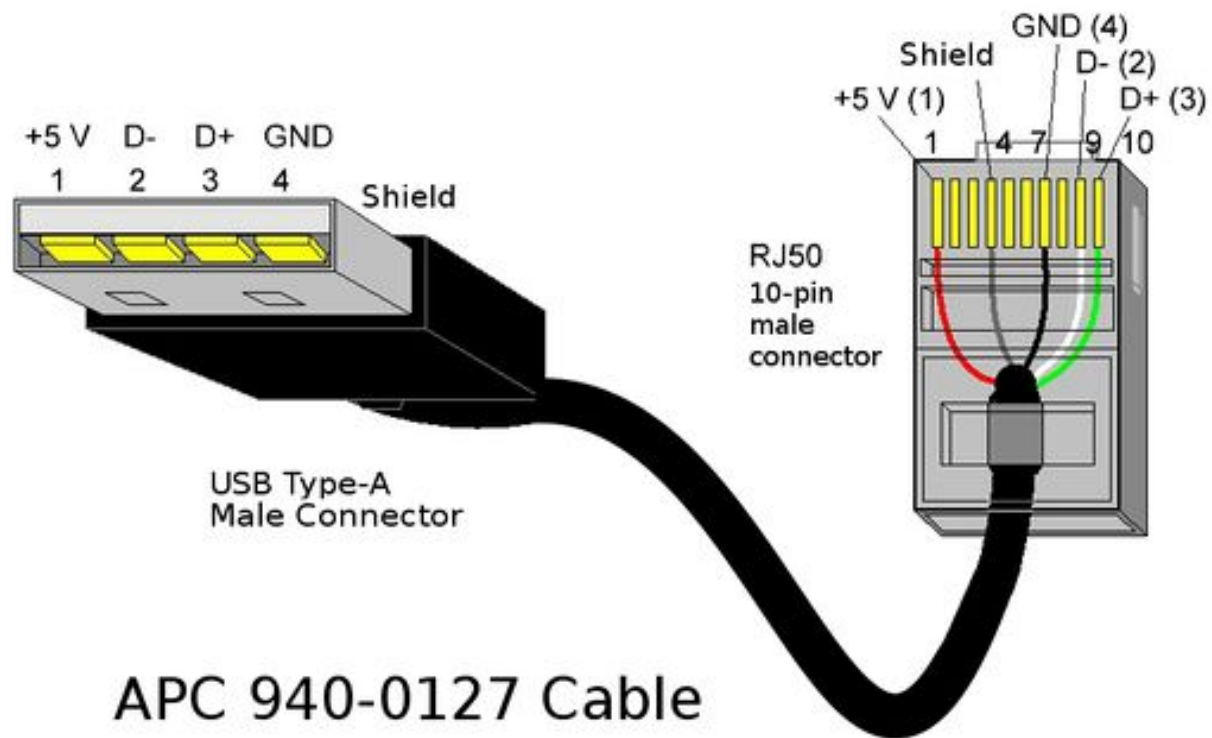

APC 940-0127 Cable

Software Setup

See [NUT - Network UPS Tools](#) for alternative software.

<https://sandilands.info/sgordon/using-apcupsd-to-trigger-ubuntu-shutdown-from-ups>

<https://www.pontikis.net/blog/apc-ups-master-slave-setup-apcupsd>

Master (connected by USB)

Install apcupsd

```
$ sudo apt-get install apcupsd
```

Edit the configuration

```
$ sudo vi /etc/apcupsd/apcupsd.conf
```

Set the following values

```
UPSNAME MyUPS
```

```
UPSCABLE usb  
UPSTYPE usb  
DEVICE
```

```
NETSERVER on  
NISIP 0.0.0.0  
NISPORT 3551  
#NISPORT 3493
```

```
# If during a power failure, the remaining battery percentage  
# (as reported by the UPS) is below or equal to BATTERYLEVEL,  
# apcupsd will initiate a system shutdown.  
BATTERYLEVEL 50
```

```
# If during a power failure, the remaining runtime in minutes  
# (as calculated internally by the UPS) is below or equal to MINUTES,  
# apcupsd, will initiate a system shutdown.  
MINUTES 10
```

Restart apcupsd

```
$ /etc/init.d/apcupsd restart
```

Test local configuration

```
$ apcaccess status
```

```
APC      : 001,036,0860  
DATE     : 2021-08-23 15:54:25 -0400  
HOSTNAME : deepthought  
VERSION  : 3.14.14 (31 May 2016) debian  
UPSNAME  : MehanUPS  
CABLE    : USB Cable  
DRIVER   : USB UPS Driver  
UPSMODE  : Stand Alone  
STARTTIME: 2021-08-23 15:44:07 -0400  
MODEL    : Back-UPS ES 750  
STATUS   : ONLINE  
...  
END APC  : 2021-08-23 15:54:30 -0400
```

Test the network connection

```
$ apcaccess status 192.168.1.50:3551
```

Network Slaves

Install apcupsd

```
$ sudo apt-get install apcupsd
```

Edit the configuration

```
$ sudo vi /etc/apcupsd/apcupsd.conf
```

Set the following values

```
UPSCABLE ether
UPSTYPE net
#DEVICE <masterIP>:<port>
DEVICE 192.168.1.50:3551

# If during a power failure, the remaining battery percentage
# (as reported by the UPS) is below or equal to BATTERYLEVEL,
# apcupsd will initiate a system shutdown.
BATTERYLEVEL 50

# If during a power failure, the remaining runtime in minutes
# (as calculated internally by the UPS) is below or equal to MINUTES,
# apcupsd, will initiate a system shutdown.
MINUTES 10
```

Restart apcupsd

```
$ /etc/init.d/apcupsd restart
```

Test local configuration

```
$ apcaccess status
```

```
APC      : 001,036,0917
DATE     : 2021-08-23 16:05:50 -0400
HOSTNAME : nas0
VERSION  : 3.14.10 (13 September 2011) debian
UPSNAME  : MehanUPS
CABLE    : Ethernet Link
DRIVER    : Back-UPS ES 750
UPSMODE  : Stand Alone
STARTTIME: 2021-08-23 16:01:50 -0400
MASTERUPD: 2021-08-23 16:05:50 -0400
MASTER   : 192.168.1.50:3551
STATUS    : ONLINE SLAVE
LINEV     : 121.0 Volts
LOADPCT   : 13.0 Percent Load Capacity
BCHARGE   : 100.0 Percent
TIMELEFT  : 13.6 Minutes
MBATTCHG  : 0 Percent
MINTIMEL  : 3 Minutes
MAXTIME   : 0 Seconds
SENSE     : Medium
LOTRANS   : 092.0 Volts
HITRANS   : 139.0 Volts
BATTV     : 13.6 Volts
LASTXFER  : Low line voltage
NUMXFERS  : 0
TONBATT   : 0 seconds
CUMONBATT : 0 seconds
XOFFBATT  : N/A
SELFTTEST : NO
STATFLAG  : 0x07000408 Status Flag
SERIALNO  : 5B1036T73179
BATTDATE  : 2010-09-05
NOMINV    : 120 Volts
NOMBATTV  : 12.0 Volts
NOMPOWER  : 450 Watts
FIRMWARE  : 841.I3 .D USB FW:I3
END APC   : 2021-08-23 16:06:39 -0400
```

References

Reference	URL
Manual	BE750G.pdf
	SCON-89HM8Q_R4_EN (1).pdf
Using apcupsd to Trigger Ubuntu Shutdown from UPS	https://sandilands.info/sgordon/using-apcupsd-to-trigger-ubuntu-shutdown-from-ups
apcupsd	https://wiki.ubuntu.com/apcupsd
How to Use APC UPS with Two or More Computers – apcupsd Master Slave Setup	https://www.pontikis.net/blog/apc-ups-master-slave-setup-apcupsd
NUT - Network UPS Tools	https://networkupstools.org/download.html